


NOTES:

1. ALL STANDARD MANHOLE SPECIFICATIONS APPLY TO THIS MANHOLE.
2. CORE DIAMETER HOLE TO ACCOMMODATE PVC PIPE (SDR-21 OR SCHEDULE 40) AND LINK SEALS THAT SURROUND PIPE. LINK SEALS MATERIAL AND INSTALLATION SHALL BE SUBJECT TO SEWER DEPARTMENT APPROVAL. LINK SEALS SHALL BE PLACED ON BOTH FACES OF THE WALL.
3. SANITARY MAIN CONNECTION MUST BE APPROVED BY THE SEWER DEPARTMENT.
4. CONCRETE BENCHWALL SLOPE 1/2"/FT.
5. ELBOW DISCHARGE TO BE IN THE DIRECTION OF FLOW (MAX. 30° ROTATION FROM FLOW PATH).

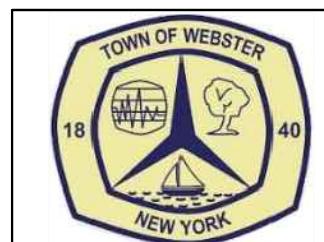

INSIDE DROP MANHOLE

SCALE: N.T.S.

FEBRUARY 2023

SA-004