


NOTES:

1. THE EXISTING FRAME & COVER SHALL BE REPLACED WITH A COMPOSITE FRAME & FRAME AND COVER SHALL BE CERTIFIED FOR H20 LOADINGS. IF EXISTING FRAME AND COVER MEETS THESE REQUIREMENTS, AND IS IN ACCEPTABLE CONDITION (SUBJECT TO SEWER DEPARTMENT REVIEW), IT MAY BE REUSED AS PART OF THE GRADE ADJUSTMENT PROJECT.
2. MAXIMUM NUMBER OF ALLOWABLE PRECAST CONCRETE GRADE RINGS IS 3.
3. DEPENDING ON THE DEPTH OR AN ECCENTRIC CONE SECTION ENCOUNTERED, THE CONTRACTOR MAY BE REQUIRED TO ADJUST THE MANHOLE UTILIZING PRECAST REINFORCED CONCRETE BARREL RISER SECTIONS.

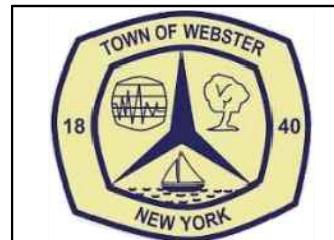

MANHOLE GRADE ADJUSTMENT

SCALE: N.T.S.

FEBRUARY 2023

SA-007