



NOTES:


1. GLUED OR GASKET FITTINGS MAY BE USED
2. INSERTA-TEE CONNECTION SUBJECT TO SEWER DEPARTMENT REVIEW AND APPROVAL (SCHEDULE INSPECTION OF LATERAL CONNECTION AT LEAST 48 HOURS IN ADVANCE).
3. NO 90° BENDS WILL BE ALLOWED
4. STONE ENCASEMENT SHALL BE NO. 1 & NO. 2 CRUSHED WASHED STONE.
5. PVC SHALL BE SCH. 40 OR SDR-21 MIN.

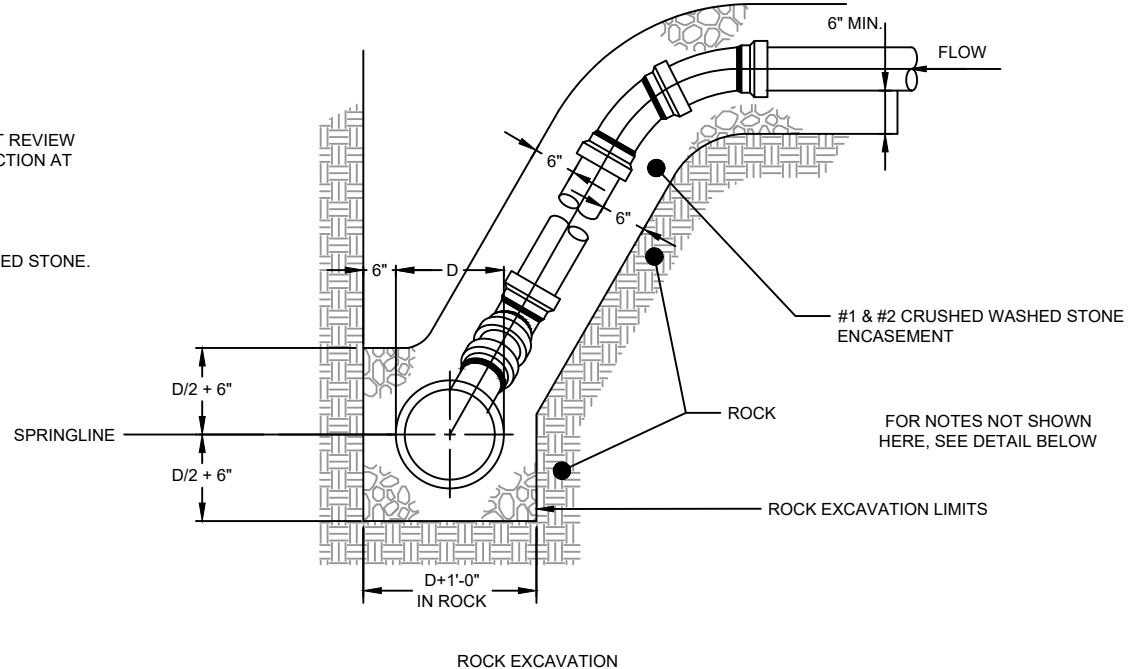

ROCK EXCAVATION

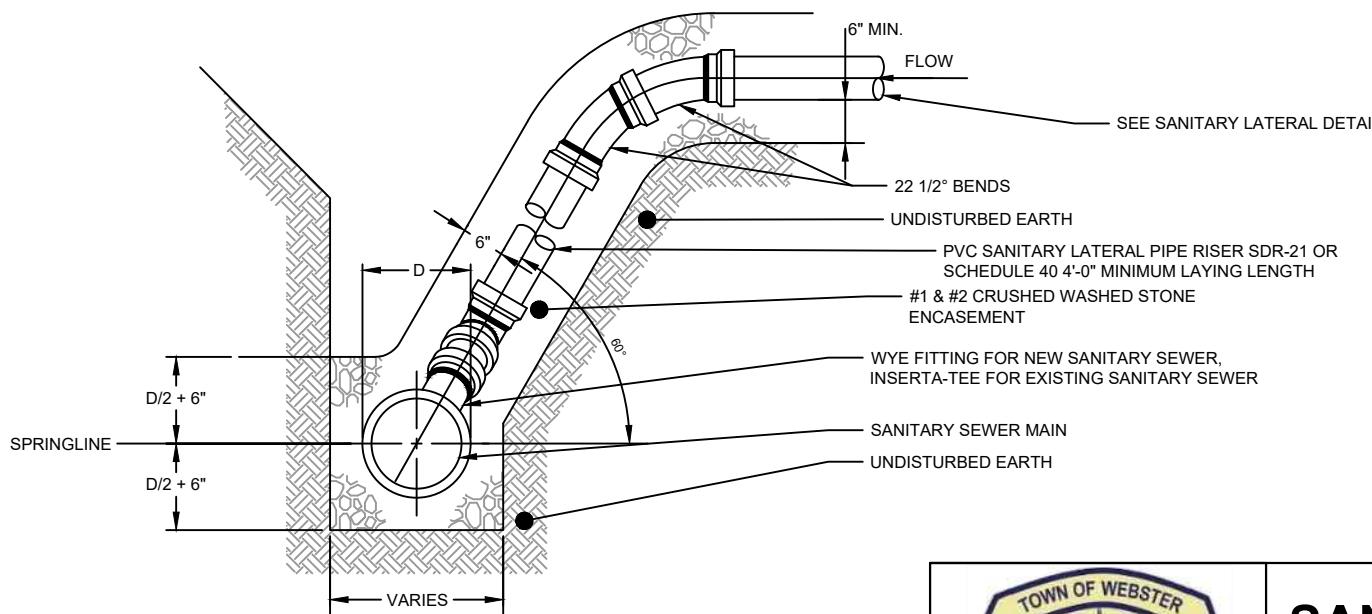

EARTH EXCAVATION

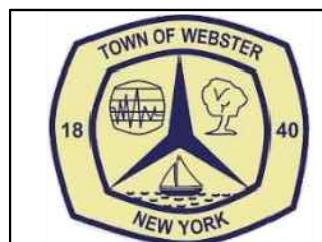

## SANITARY LATERAL RISER

SCALE: N.T.S.

FEBRUARY 2023

**SA-011**