


NOTES:

1. PRECAST CONCRETE MANHOLE WALL & SLAB MINIMUM THICKNESS
MANHOLE DIAMETER 4FT. 5FT. 6FT.
A. TOP SLAB 8" 8" 8"
B. RISER WALL 5" 6" 7"
C. BOTTOM SLAB 8" 8" 8"
2. MAXIMUM DISTANCE BETWEEN MANHOLES SHALL BE 300 FEET.
3. CORE DIAMETER HOLE TO ACCOMMODATE PVC PIPE (SDR-21 OR SCHEDULE 40 MIN.) AND LINK SEALS THAT SURROUND PIPE. LINK SEALS MATERIAL AND INSTALLATION SHALL BE SUBJECT TO SEWER DEPARTMENT APPROVAL. LINK SEALS SHALL BE PLACED ON BOTH FACES OF THE WALL.

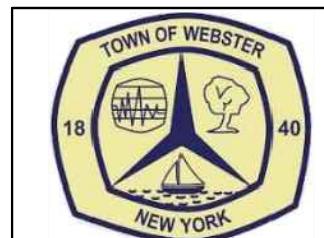

SANITARY MANHOLE

SCALE: N.T.S.

FEBRUARY 2023

SA-012