


NOTES:

1. INSTALLATION SUBJECT TO SEWER DEPARTMENT APPROVAL. SCHEDULE AT LEAST 48 HOURS IN ADVANCE OF INSTALL.
2. ALL 3-WAY MANHOLE CONFIGURATIONS NOT SHOWN SHALL BE 5' DIAMETER MIN.
3. INVERT SLOPES:
 - A. STRAIGHT THROUGH PIPE-SLOPES SHALL BE A MINIMUM 0.10' DROP ACROSS MANHOLE.
 - B. 90° BENDS - PROVIDE MINIMUM 0.25' DROP ACROSS MANHOLE.
 - C. WHERE TWO OR MORE PIPES ENTER A MANHOLE THE STEEPER OF THE SLOPES ABOVE WILL DETERMINE THE OUTLET ELEVATION.
 - D. WHERE PIPES ARE OF DIFFERENT SIZE, SLOPE SHALL BE AS DETERMINED BY CONTRACT PLANS.

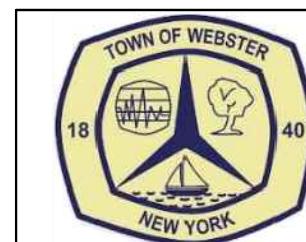

SANITARY MANHOLE INVERT CONFIGURATIONS & DIMENSIONS

SCALE: N.T.S.

FEBRUARY 2023

SA-014